



62 rue de Lamiraut  
Collégien  
77615 MARNE LA VALLEE CEDEX 3  
FRANCE  
www.aereco.com

D4538\_B












Pressure measurement  
put back original settings

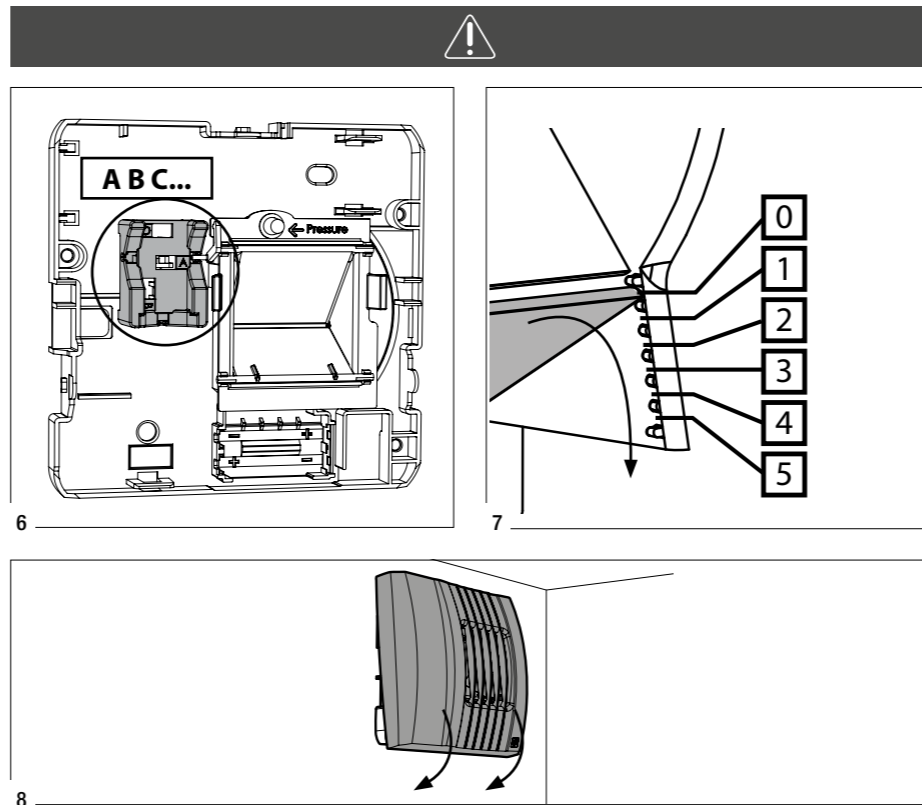


Pressure measurement

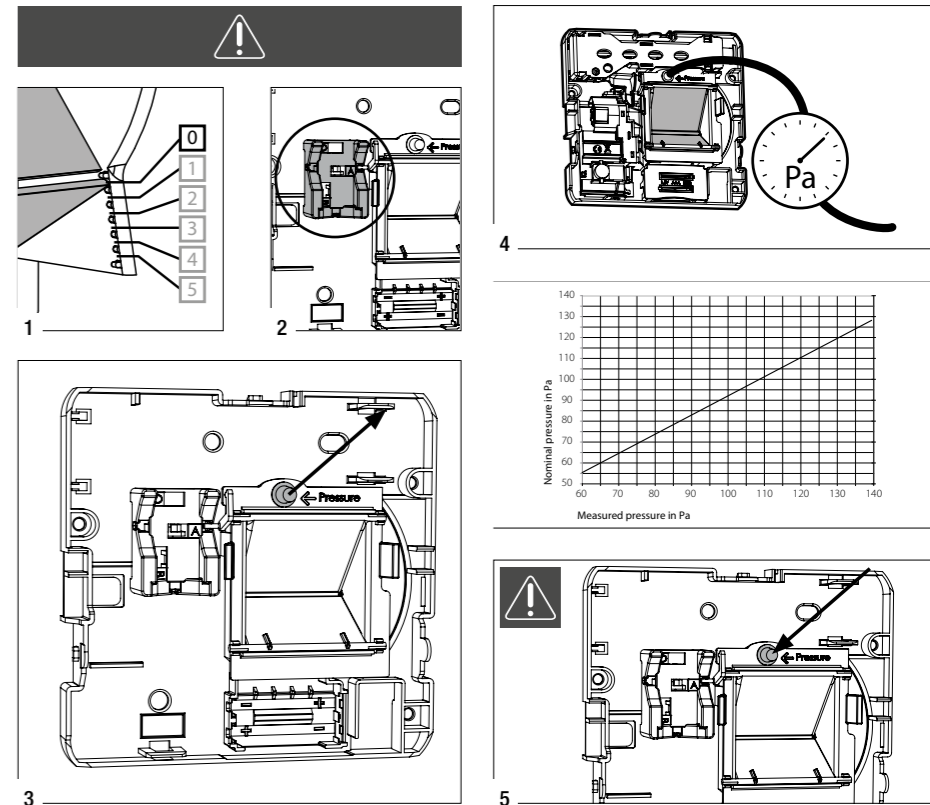

# BFX

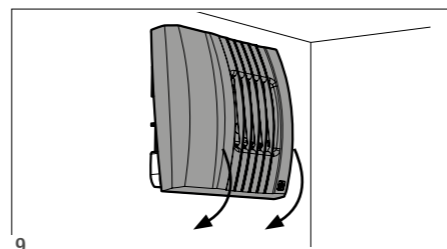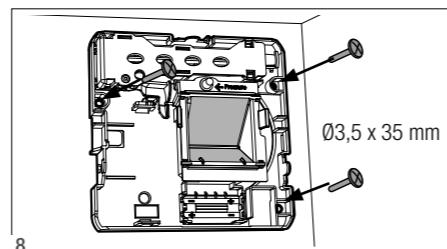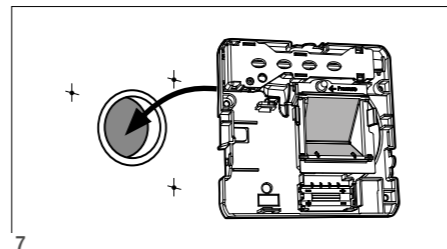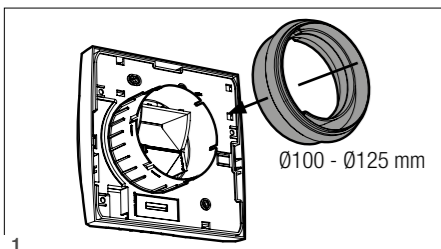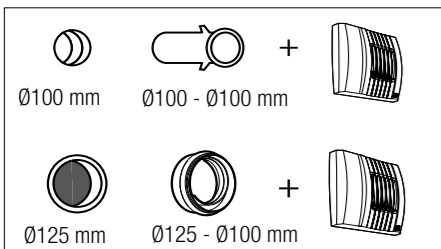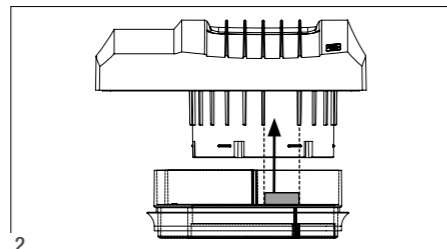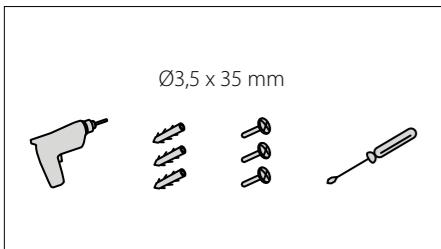

## Airflow setting

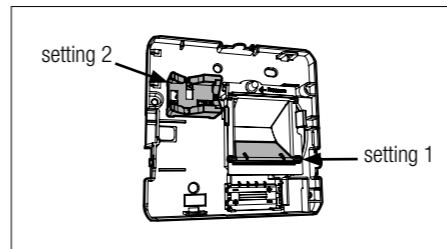

		Ø100 mm		
		setting 2		
Airflow (m <sup>3</sup> /h) @ 100 Pa		A	B	C
setting 1	0	12	50	80
	1	18	55	90
	2	24	60	100
	3	30	70	110
	4	36	80	120
	5	42	90	130

		Ø125 mm		
		setting 2		
Airflow (m <sup>3</sup> /h) @ 100 Pa		A	B	C
setting 1	0	12	50	70
	1	18	55	80
	2	24	60	90
	3	30	70	100
	4	36	75	110
	5	42	80	120

