


Key

- ① ——— Decothane Base Coat applied throughout all gutter areas; embedded with a continuous layer of Sika Reemat Premium
- ② ——— Decothane Top Coat/s applied in strict accordance with Sika Liquid Plastics Project Specification
- ③ ——— Carrier Membrane bonded with Decostik in strict accordance with Liquid Plastics Project Specification
- ④ Mechanically fixed exterior grade WBP plywood gutter sole and layboard
- ⑤ - - - - - Existing sarking [when present] should be dressed over the termination point of the Decothane Waterproofing System
- ⑥ Timber tilting fillet: besides it's normal function of supporting the under-eaves tile/slate and as a watercheck for wind-driven surface water, it also provides a convenient stop-end for the Decothane Waterproofing System
- ⑦ Existing roof tiles/slates and existing sarking felt must be checked by a competent person to guarantee the roof waterproofing integrity as forced-entry rainwater ingress must be eliminated from the pitched roof

- ⑧ Fully reinforced Decothane Waterproofing System dressed **minimum 150mm above finished gutter level** on to prepared and appropriately primed upstands
- ⑨ Decothane Waterproofing System dressed on to prepared primed upstands, terminated in the protected junction between upstand and coping; once cured, seal with a continuous minimum 6mm bead of SikaHyflex-250 Facade sealant
- ⑩ Underside of the coping should not be coated to prevent sagging of the embedded Reemat Premium whilst curing
- ⑪ **OPTIONAL:** Decothane Waterproofing System dressed over soundly adhered, prepared and primed existing copings; system terminated on the external drip edges of the existing coping

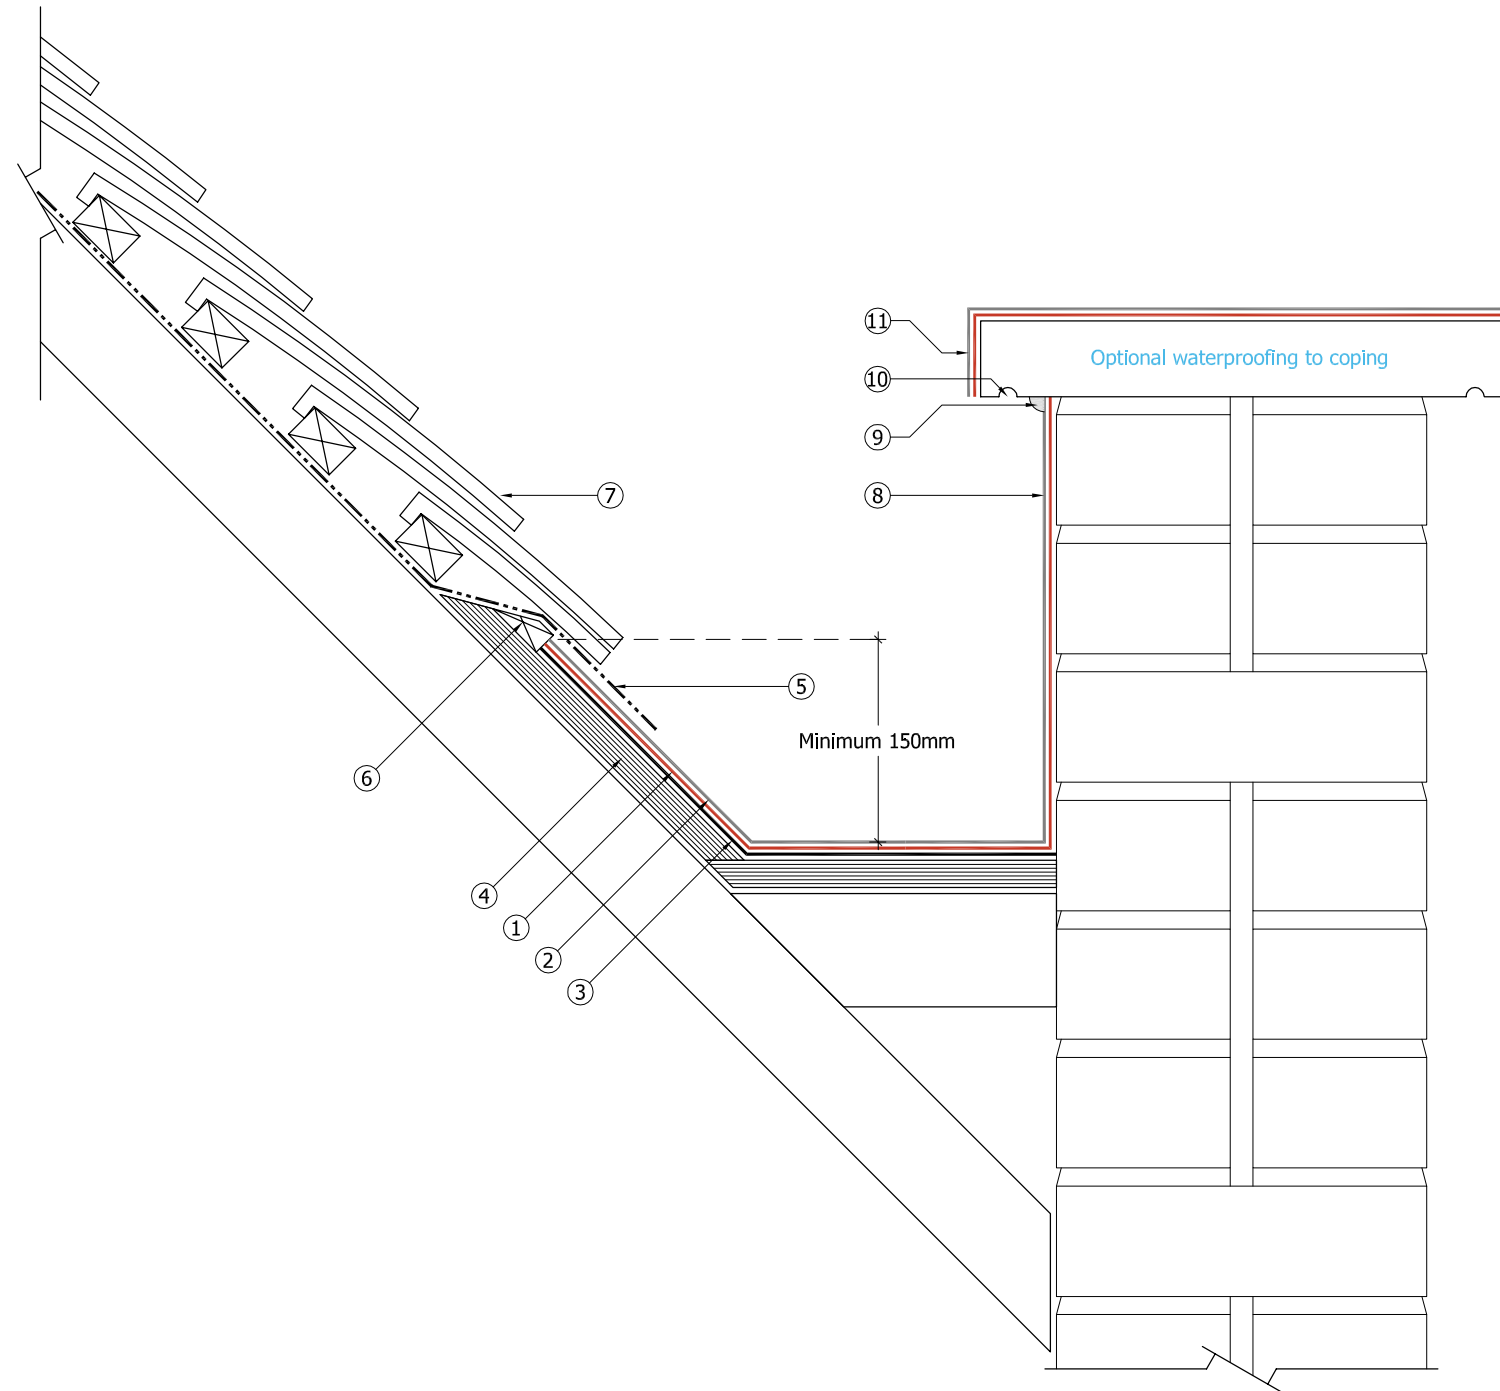

Sika Liquid Plastics
 Sika House
 Miller Street
 Preston
 Lancashire PR1 1EA
 Telephone: 01772 259781
 Email: technical.customer.services@uk.sika.com
www.liquidplastics.co.uk

This drawing is solely intended to illustrate the correct application of Sika Liquid Plastics products and systems. It must be read in conjunction with the appropriate specification and current issue of relevant Product Data Sheets. All elements bearing reference to structural and/or thermal design are shown indicatively and **should not be used** in whole or in part for any aspect of project design without consulting the relevant authorities.

For refurbishment projects, all aspects of the existing roof are deemed to be fully compliant with BS 6229:2003 (Code of Practice for Flat Roofs with Continuously Supported Coverings) or improved upon for instances where these standards are not met.

Site-specific details not covered by our standard range can be obtained by providing relevant information to the email address shown.

Project N ^o	
DWG N ^o	Revision
Project:	
Drawing Title: Waterproofing Termination to a typical parapet detail with a concealed box gutter	
Scale: NTS @ A3	Drawn:
Date:	

