


Key

- ① ——— Sikalastic 618 Top Coat as per Sika Liquid Plastics Project Specification
- ② ——— Sikalastic 618 Embedment Coat with embedded Sika Reemat Premium GFM
- ③ Existing substrate prepared and primed in strict accordance with Sika Liquid Plastics Project Specification
- ④ Sikalastic 618 Waterproofing System dressed on to prepared primed upstands, terminated in the protected junction between upstand and coping; once cured, seal with a continuous minimum 6mm bead of SikaHyflex-250 Facade sealant
- ⑤ Underside of the coping should not be coated to prevent sagging of the Embedment Coat and Sika Reemat Premium whilst curing
- ⑥ Sikalastic 618 Waterproofing System dressed over soundly adhered, prepared and primed existing copings; system terminated on the external drip edges of the existing coping

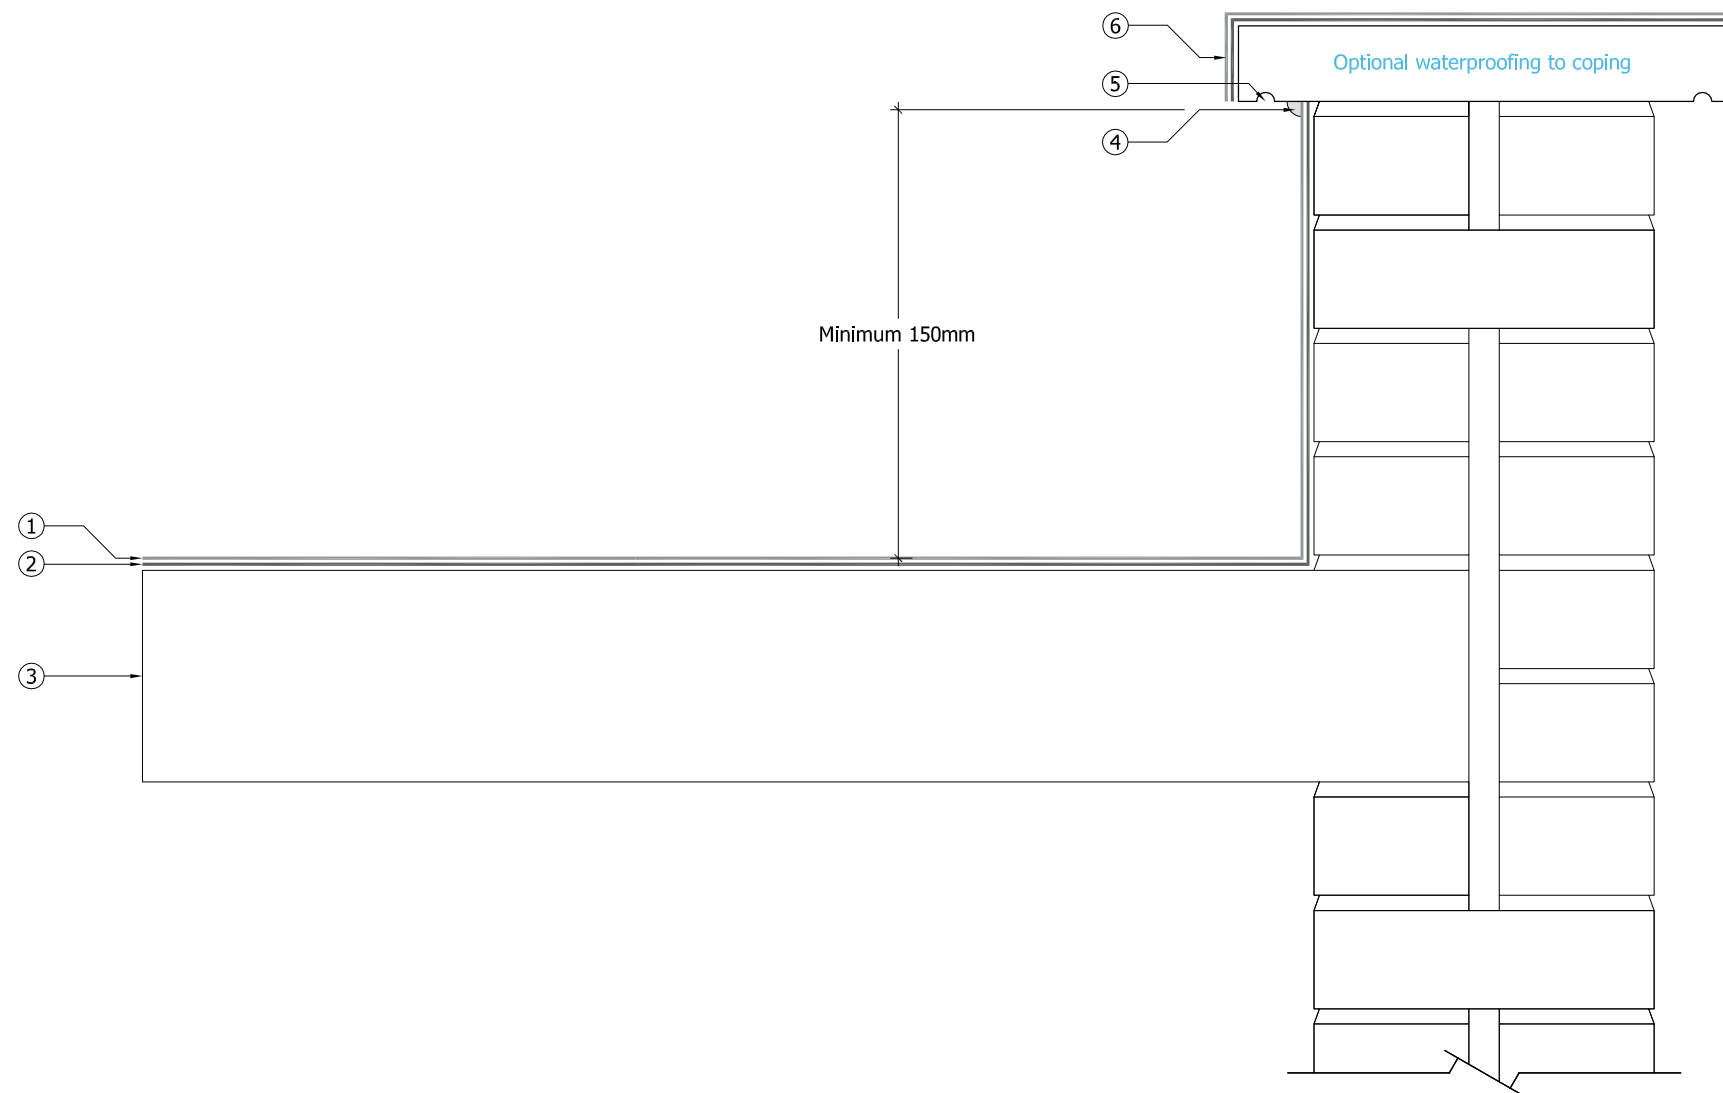

Sika Liquid Plastics
 Sika House
 Miller Street
 Preston
 Lancashire PR1 1EA
 Telephone: 01772 259781
 Email: technical.customer.services@uk.sika.com
www.liquidplastics.co.uk

This drawing is solely intended to illustrate the correct application of Sika Liquid Plastics products and systems. It must be read in conjunction with the appropriate specification and current issue of relevant Product Data Sheets. All elements bearing reference to structural and/or thermal design are shown indicatively and **should not be used** in whole or in part for any aspect of project design without consulting the relevant authorities.

For refurbishment projects, all aspects of the existing roof are deemed to be fully compliant with BS 6229:2003 (Code of Practice for Flat Roofs with Continuously Supported Coverings) or improved upon for instances where these standards are not met.

Site-specific details not covered by our standard range can be obtained by providing relevant information to the email address shown.

Project N ^o	
DWG N ^o	Revision

Project:

Drawing Title:
 Waterproofing Termination Detail
 under existing coping with option
 to coat the existing copings

Scale: NTS @ A3 Drawn:

Date:

