



INVESTOR IN PEOPLE

Holbrook House, Little Waldingfield,  
Sudbury, Suffolk CO10 0TH  
Tel: (01787) 247595 Fax: 01787 248420  
e-mail: srl@srltsl.com

Contract C/21920

Page: 1 of 1

Date: 2 November 2011


See SRL report C/21920/R01 for full details

The Laboratory Measurement of Random Incidence Sound Absorption to BS EN ISO 354:2003

**Client:** Soundtect  
**Test Date:** 14/10/2011  
**Empty Room:** Temperature: 17.0 °C Humidity: 56 %RH Pressure: 1025 mbar  
**Room with Sample:** Temperature: 16.9 °C Humidity: 47 %RH Pressure: 1025 mbar  
**Sample Description:** Cubism (Purple) panels with foam

**Mounting Method:** A  
**Sample Area:** 11.2 m<sup>2</sup>  
**Chamber Volume:** 300 m<sup>3</sup>

Test 3				
Freq Hz	T1 sec	T2 sec	Absorp Coeff	Practical Absorp Coeff #
50*	5.89	5.99	-0.01	
63*	5.36	4.67	0.12	n/a
80*	5.94	5.37	0.08	
100	8.60	6.05	0.21	
125	8.52	5.81	0.24	0.25
160	8.59	5.15	0.34	
200	7.85	4.17	0.49	
250	7.51	3.56	0.64	0.65
315	7.98	3.23	0.80	
400	7.01	2.77	0.95	
500	5.91	2.48	1.02	1.00
630	5.38	2.23	1.14	
800	5.82	2.41	1.06	
1000	6.47	2.56	1.02	1.00
1250	6.46	2.61	0.99	
1600	5.77	2.51	0.96	
2000	5.20	2.47	0.89	0.90
2500	4.58	2.34	0.86	
3150	3.82	2.11	0.84	
4000	3.09	1.84	0.82	0.80
5000	2.44	1.58	0.75	
6300*	1.74	1.18	0.85	
8000*	1.39	0.99	0.78	n/a
10000*	0.98	0.75	0.68	

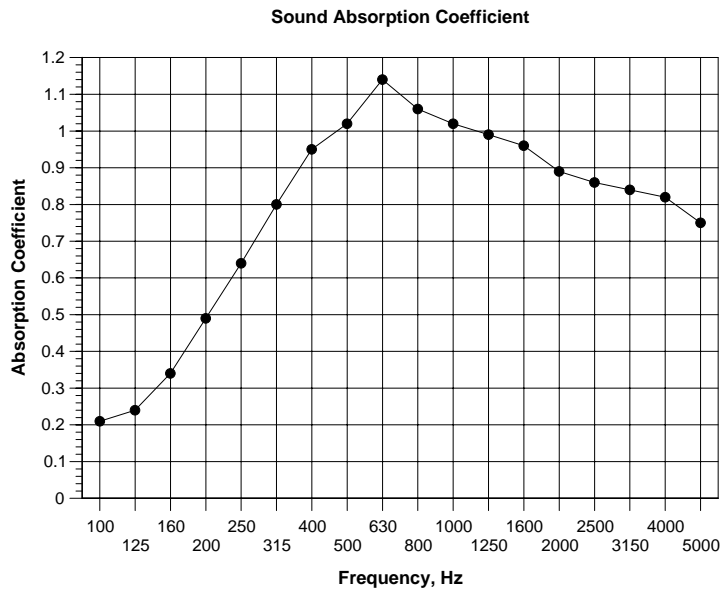

$\alpha_w$  0.90  
**Class A**  
 Calculated to EN ISO 11654:1997  
**NRC 0.90**  
 Calculated to ASTM C 423-01  
 \* Denotes frequencies outside the range covered by BS EN ISO 354:2003  
 T1, empty room reverberation time  
 T2, room reverberation time with sample

# Practical absorption coefficient, BS EN ISO 11654:1997

v4.0