

Acoustic data



Standard: BS EN 13141-7:2010

Ventilation for buildings. Performance testing of components/products for residential ventilation. Performance testing of a mechanical supply and exhaust ventilation units (including heat recovery) for mechanical ventilation systems intended for single family dwellings

Product **H200 Q Plus Eco**

Speed		'A' Weighted Sound Power Levels dB re. 1pW								Overall L <sub>W</sub>	Overall L <sub>WA</sub>	Casing Breakout dBA @ 3m
		Frequency Hz										
		63	125	250	500	1k	2k	4k	8k			
14l/s @ 3Pa (18%)	Induct Outlet	25	24	33	29	23	16	19	22	52	36	10
	Induct Inlet	28	27	27	20	16	14	19	23	55	33	
	Breakout	14	15	22	17	18	15	18	21	41	27	
27l/s @ 9Pa (30%)	Induct Outlet	26	27	38	45	36	28	22	23	54	46	17
	Induct Inlet	32	29	29	31	20	16	19	23	58	37	
	Breakout	24	25	31	29	25	18	18	21	51	35	
39l/s @ 20Pa (41%)	Induct Outlet	30	31	45	52	47	39	34	27	60	54	25
	Induct Inlet	33	30	36	36	36	24	19	23	60	42	
	Breakout	29	33	38	36	37	25	19	21	57	43	
53l/s @ 37Pa (53%)	Induct Outlet	34	37	51	54	53	47	43	36	65	58	31
	Induct Inlet	37	36	42	39	40	38	23	23	64	47	
	Breakout	31	40	44	40	42	33	25	22	61	48	
64l/s @ 60Pa (65%)	Induct Outlet	38	40	56	59	61	53	49	44	69	64	37
	Induct Inlet	42	39	46	43	46	42	28	24	68	51	
	Breakout	37	44	48	44	51	39	30	23	66	54	
75l/s @ 81Pa (77%)	Induct Outlet	41	43	59	62	69	58	54	49	74	71	39
	Induct Inlet	47	42	49	46	49	45	33	26	73	55	
	Breakout	39	47	52	48	53	44	35	26	68	57	
82l/s @ 100Pa (88%)	Induct Outlet	44	45	61	64	67	62	57	52	75	71	41
	Induct Inlet	45	44	52	48	49	48	36	28	72	56	
	Breakout	40	49	54	50	52	49	38	28	70	59	
83l/s @ 100Pa (100%)	Induct Outlet	43	45	61	64	67	62	57	52	75	71	41
	Induct Inlet	45	44	52	48	49	48	36	28	72	56	
	Breakout	41	49	54	50	52	49	38	28	70	58	

Measurements taken at full speed with a resistance of 100Pa, then at the stated percentage speed settings of the unit and corresponding reduced pressure  
 Inlet and outlet levels are Induct (BS EN 13141-7 clause 6.4.2 requirement), casing breakout is hemispherical - for spherical subtract 3dB

Titon acoustic data is independently tested at Sound Research Laboratories

Data is specifically tested for the Eco unit (100% bypass) - non bypass variants with deeper heat exchangers will offer lower acoustic levels

Product **H200 Q Plus Eco**

		Sound Power Levels dB re. 1pW								Overall $L_W$	Overall $L_{WA}$	Overall dBA @ 3m Hemispherical	Overall dBA @ 3m Spherical
		Frequency Hz											
Speed		63	125	250	500	1k	2k	4k	8k				
14l/s @ 3Pa (18%)	Open Outlet	31	26	33	28	22	15	18	23	37	30	13	10
	Open Inlet	34	29	27	19	15	13	18	24	36	26	9	6
	Breakout	40	31	31	20	18	14	17	22	41	27	10	7
27l/s @ 9Pa (30%)	Open Outlet	32	29	38	44	35	27	21	24	45	42	24	21
	Open Inlet	38	31	29	30	19	15	18	24	40	30	13	10
	Breakout	50	41	40	32	25	17	17	22	51	35	17	14
39l/s @ 20Pa (41%)	Open Outlet	36	33	45	51	46	38	33	28	53	51	33	30
	Open Inlet	39	32	36	35	35	23	18	24	43	38	20	17
	Breakout	55	49	47	39	37	24	18	22	57	43	25	22
53l/s @ 37Pa (53%)	Open Outlet	40	39	51	53	52	46	42	37	57	55	38	35
	Open Inlet	43	38	42	38	39	37	22	24	48	43	26	23
	Breakout	57	56	53	43	42	32	24	23	61	48	31	28
64l/s @ 60Pa (65%)	Open Outlet	44	42	56	58	60	52	48	45	64	62	45	42
	Open Inlet	48	41	46	42	45	41	27	25	52	48	30	27
	Breakout	63	60	57	47	51	38	29	24	66	54	37	34
75l/s @ 81Pa (77%)	Open Outlet	47	45	59	61	68	57	53	50	70	69	52	49
	Open Inlet	53	44	49	45	48	44	32	27	56	51	33	30
	Breakout	65	63	61	51	53	43	34	27	68	57	39	36
82l/s @ 100Pa (88%)	Open Outlet	50	47	61	63	66	61	56	53	70	69	51	48
	Open Inlet	51	46	52	47	48	47	35	29	57	52	35	32
	Breakout	66	65	63	53	52	48	37	29	70	59	41	38
83l/s @ 100Pa (100%)	Open Outlet	49	47	61	63	66	61	56	53	70	69	51	48
	Open Inlet	51	46	52	47	48	47	35	29	57	52	35	32
	Breakout	67	65	63	53	52	48	37	29	70	58	41	38

Measurements taken at full speed with a resistance of 100Pa, then at the stated percentage speed settings of the unit and corresponding reduced pressure  
 To enable simplified comparisons with other manufacturers data the above information is tested in accordance with BS EN 13141-7, the end reflection as defined in EN ISO 5135  
 for a 125mm (204x60mm) duct mounted flush with the wall, has been removed to provide an open outlet/open inlet sound power measurement (see page 1 of 2 for original data)  
 Figures shown are not 'A' weighted (other than the overall  $L_{WA}$ /dBA columns)

Titon acoustic data is independently tested at Sound Research Laboratories  
 Data is specifically tested for the Eco unit (100% bypass) - non bypass variants with deeper heat exchangers will offer lower acoustic levels

## Acoustic Testing – Powered products

Acoustic testing of Titon mechanical ventilation products is measured in accordance with the following standards:-

**CME – BS EN 13141-6** – “Ventilation for buildings. Performance testing of components/products for residential ventilation. Exhaust ventilation system packages used in a single dwelling”

**MVHR – BS EN 13141-7** – “Ventilation for buildings. Performance testing of components/products for residential ventilation. Performance testing of a mechanical supply and exhaust ventilation units (including heat recovery) for mechanical ventilation systems intended for single family dwellings”

The results (1<sup>st</sup> page) are presented in the following format which provides details of the acoustic performance of the unit at each of the standard speed settings.

The ‘A’ Weighted Sound Power Level in dB is an “in-duct” measurement for the Outlet (supply) and Inlet (extract) and are given across the frequency range from 63Hz to 8kHz.

The overall level is the logarithmic addition of the frequency bands to give a single figure, this is provided with and without ‘A’ weighting

The casing breakout is a sound pressure level at a distance of 3 metres, this figure is the lowest quoted and is usually stated in catalogue details. It is calculated from the Overall L<sub>WA</sub> (sound power level) with a reduction to convert to the sound pressure at 3 metres (see page 7).

### Acoustic data



Standard: BS EN 13141-7:2010

Ventilation for buildings. Performance testing of components/products for residential ventilation. Performance testing of a mechanical supply and exhaust ventilation units (including heat recovery) for mechanical ventilation systems intended for single family dwellings

Product: **HRV2.85 Plus Eco**

Speed		'A' Weighted Sound Power Levels dB re. 1pW								Overall L <sub>W</sub>	Overall L <sub>WA</sub>	Casing Breakout dB(A) @ 3m
		Frequency Hz										
		63	125	250	500	1k	2k	4k	8k			
15l/s @ 1Pa (18%)	Induct Outlet	28	35	32	32	27	17	19	23	56	39	11
	Induct Inlet	28	28	25	21	15	15	14	23	54	33	
	Breakout	4	16	17	25	21	17	18	21	36	29	
29l/s @ 7Pa (30%)	Induct Outlet	34	46	41	45	41	33	24	23	64	50	14
	Induct Inlet	30	34	33	30	24	20	19	23	57	39	
	Breakout	7	22	21	27	25	19	19	21	40	31	
45l/s @ 18Pa (41%)	Induct Outlet	37	52	48	54	54	44	36	30	70	59	19
	Induct Inlet	33	41	40	37	35	29	22	23	61	45	
	Breakout	9	28	26	31	31	24	21	21	45	36	
61l/s @ 40Pa (53%)	Induct Outlet	44	57	53	59	61	51	45	41	75	64	24
	Induct Inlet	38	46	45	43	43	36	28	24	66	51	
	Breakout	14	33	32	36	37	30	26	21	51	41	
75l/s @ 65Pa (65%)	Induct Outlet	48	59	58	63	65	57	50	47	79	69	27
	Induct Inlet	41	49	48	47	48	41	33	27	70	55	
	Breakout	16	36	35	40	40	34	31	22	54	45	
88l/s @ 83Pa (76.5%)	Induct Outlet	51	62	62	65	69	62	55	52	82	72	33
	Induct Inlet	46	52	52	50	51	45	37	31	74	58	
	Breakout	19	40	40	48	44	40	37	25	59	51	
93l/s @ 100Pa (100%)	Induct Outlet	51	64	63	66	70	63	55	53	82	73	34
	Induct Inlet	46	53	53	51	52	47	39	33	74	59	
	Breakout	24	41	42	48	46	42	39	27	59	52	

Measurements taken at full speed with a resistance of 100Pa, then at the stated percentage speed settings of the unit and corresponding reduced pressure

Inlet and outlet levels are Induct (BS EN 13141-7 clause 6.4.2 requirement), casing breakout is hemispherical - for spherical subtract 3dB

Titon acoustic data is independently tested at Sound Research Laboratories

Data is specifically tested for the Eco unit (100% bypass) - non bypass variants with deeper heat exchangers will offer lower acoustic levels

MD0268f-03, SRL report 23276/T01, 07/10/16

A second page of the same results is also provided with the same information presented in an alternative format, this is provided to enable simplified direct comparisons to some competitor units where “open outlet” or “open inlet” data is being quoted (outside the requirements of 13141-7).

The overall level is the logarithmic addition of the frequency bands to give a single figure, this is provided with and without ‘A’ weighting.

The open outlet and open inlet figures are calculated from the induct levels given on page 1 by deducting the end reflection (as defined in EN ISO 5135 for a duct flush with the wall).

The overall levels have also been given as a sound power ( $L_w$ ) and sound pressure at a distance of 3 meters, both hemispherical and spherical. The only A weighted data is the overall “dBA” at 3 metres.

Acoustic data

Product **HRV2.85 Plus Eco**

Speed		Sound Power Levels dB re. 1pW								Overall $L_w$	Overall dBA @ 3m Hemispherical	Overall dBA @ 3m Spherical
		Frequency Hz										
		63	125	250	500	1k	2k	4k	8k			
15l/s @ 1Pa (18%)	Open Outlet	36	38	34	32	26	16	18	24	42	21	8
	Open Inlet	36	31	27	21	14	14	18	24	38	16	7
	Breakout	30	32	26	28	21	16	17	22	36	11	8
29l/s @ 7Pa (30%)	Open Outlet	42	49	43	45	40	32	23	24	52	32	29
	Open Inlet	38	37	35	30	23	19	18	24	42	21	18
	Breakout	33	38	30	30	25	18	18	22	40	14	11
45l/s @ 18Pa (41%)	Open Outlet	45	55	50	54	53	43	35	31	60	41	38
	Open Inlet	41	44	42	37	34	28	21	24	48	28	25
	Breakout	35	44	35	34	31	23	20	22	45	19	16
61l/s @ 40Pa (53%)	Open Outlet	52	60	55	59	60	50	44	42	65	47	44
	Open Inlet	46	49	47	43	42	35	27	25	53	33	30
	Breakout	40	49	41	39	37	29	25	22	51	24	21
75l/s @ 65Pa (65%)	Open Outlet	56	62	60	63	64	56	49	48	69	51	48
	Open Inlet	49	52	50	47	47	40	32	28	57	37	34
	Breakout	42	52	44	43	40	33	30	23	54	27	24
88l/s @ 83Pa (76.5%)	Open Outlet	59	65	64	65	68	61	54	53	73	55	52
	Open Inlet	54	55	54	50	50	44	36	32	60	40	37
	Breakout	45	56	49	51	44	39	36	26	59	33	30
93l/s @ 100Pa (100%)	Open Outlet	59	67	65	66	69	62	54	54	73	55	52
	Open Inlet	54	56	55	51	51	46	38	34	61	41	38
	Breakout	50	57	51	51	46	41	38	28	59	34	31

Measurements taken at full speed with a resistance of 100Pa, then at the stated percentage speed settings of the unit and corresponding reduced pressure  
To enable simplified comparisons with other manufacturers data the above information is tested in accordance with BS EN 13141-7, the end reflection as defined in EN ISO 5135 for a 125mm (204x60mm) duct mounted flush with the wall, has been removed to provide an open outlet/open inlet sound power measurement (see page 1 of 2 for original data)

Figures shown are not 'A' weighted (other than the overall dBA columns)


Titon acoustic data is independently tested at Sound Research Laboratories

Data is specifically tested for the Eco unit (100% bypass) - non bypass variants with deeper heat exchangers will offer lower acoustic levels


MD0268f-03, SRL report 23276/T01, 07/10/16

## MVHR – Installation set up used during testing

Induct sound power level measurement – the unit is installed with the outlet (or inlet) connected to the measurement room and a pressure difference of 100Pa is set across the inlet to outlet connections whilst the unit is operated at full speed. The test is then repeated to measure the casing breakout. A number of reduced speed settings are also taken with the pressure difference reducing with the flow rate.

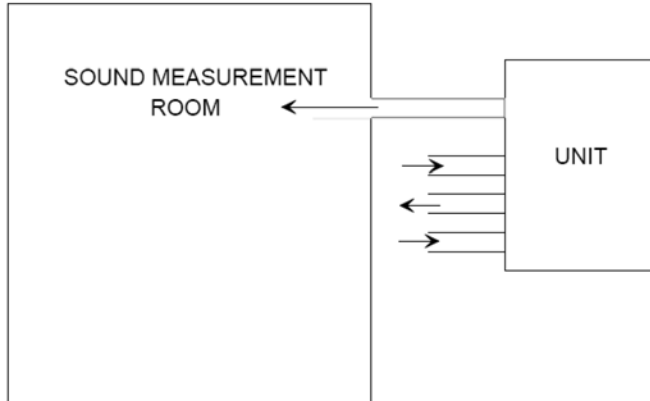


Casing breakout – the inlet and outlet ducts are connected to a separate room so the only noise measured is breakout from the casing.

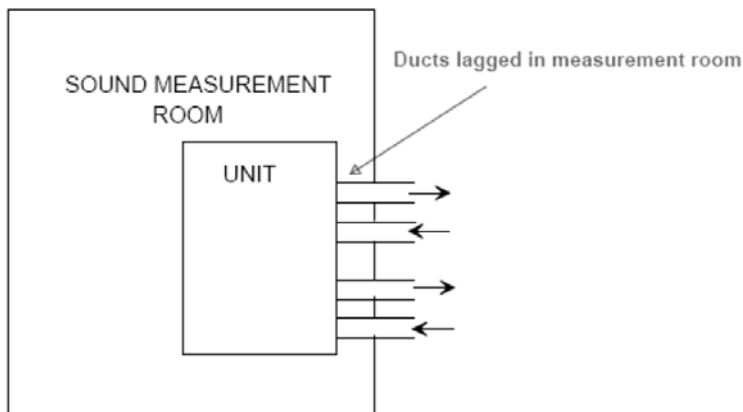


The performance graph below shows the inlet acoustic levels starting at 100Pa and also 200Pa, the acoustic level is similar at the same speed setting with a reduction of 2 dB at the higher resistance.

Example sound data based on different system resistances

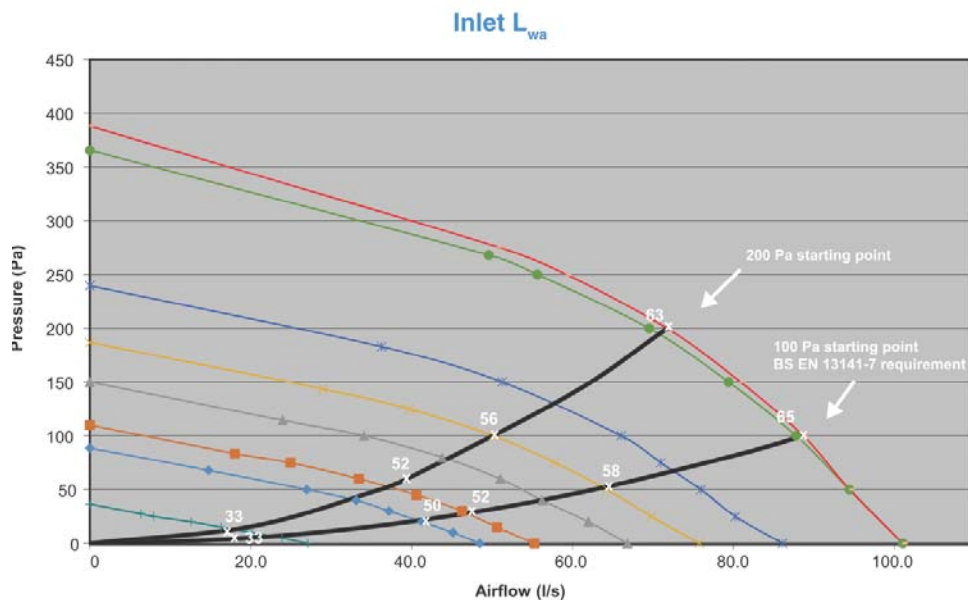


## CME – Installation set up used during testing

Inlet sound power levels – all 3 inlets from the CME are fitted with a standard duct set up (as BS EN 13141-6, one is connected to the measuring room and the inlet sound power level recorded. The three inlets connected with 90 degree bend, 0.5m duct and air terminal device. The single outlet connected with 0.5m duct, 45 degree bend 2m duct, and grille. All duct work 204 x 60mm plastic.

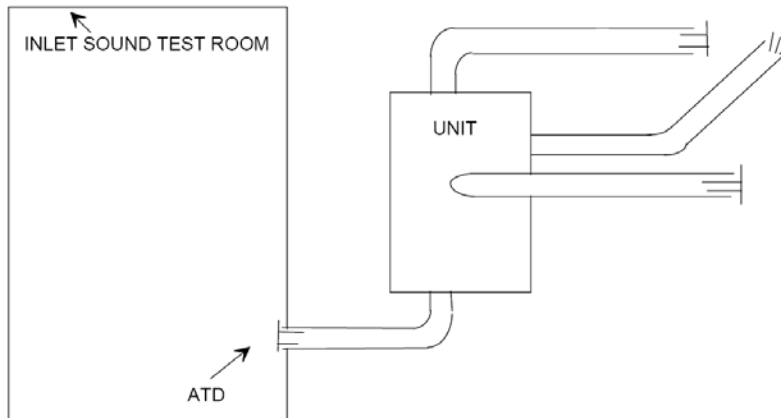

Casing breakout – the inlet and outlet ducts are connected to a separate room so the only noise measured is breakout from the casing.

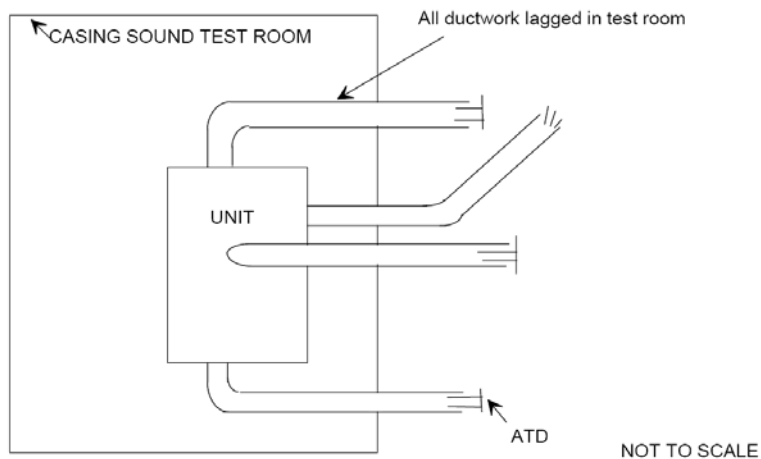

## Glossary

**Sound Power Level (SWL or  $L_{WA}$ )** – is a measurement of the actual sound level created at the source, it is not therefore affected by the environment in which the product is installed. This will always be the highest levels quoted as no reductions have been applied for either the environment or distance from the source. Actual installed levels will therefore be significantly lower than these figures but they are useful from which to base any system calculations.

**Sound Pressure Level (SPL or  $L_{pA}$ )** – this must be quoted at a given distance and is dependant on both the distance from the source and environment (a hard walled reflective surface will have a higher level than a soft furnished room which absorbs more sound). Titon levels are given at a distance of 3m (which is commonly quoted) and are free field, hemispherical radiation.

**Free field** – An environment in which there are no reflective surfaces (useful to describe the sound pressure levels for comparative purposes)

**Hemispherical radiation** – Sound radiates from a source in all directions, where the product is mounted on a wall or ceiling some sound is reflected from this mounting face. The casing sound pressure levels are based on hemispherical radiation which will be slightly higher than spherical radiation.

Calculation:

$$\text{SPL} = \text{SWL} - 20 \log r - 8 \text{ dB}, \quad \text{where } r = \text{distance from source}$$

Or, **SPL = SWL – 17.54 dB** (when  $r = 3\text{m}$ )

**Spherical radiation** –

Calculation:

$$\text{SPL} = \text{SWL} - 20 \log r - 11 \text{ dB}, \quad \text{where } r = \text{distance from source}$$

Or, **SPL = SWL – 20.54 dB** (when  $r = 3\text{m}$ ), i.e 3 dB quieter than hemispherical.

**'A'Weighting** – this is a correction to the frequency bands to replicate the sensitivity of the human ear to different frequencies. The weighting can be removed from the octave bands if required, the corrections are given in the table below.

Frequency Hz	63	125	250	500	1000	2000	4000	8000
'A' Weighting	-26	-16	-9	-3	0	1	1	-1

**Octave band** – sound is produced at various frequencies and is therefore measured across a range of frequency or Octave bands (as the above table). The figures can be combined to give an overall level using logarithmic addition.

**Induct levels** – a measurement of sound that is taken inside the duct of a ventilation system, this is likely to be a higher level than a non ducted or open inlet/open outlet measurement.

**Casing Breakout** – a measurement of the sound that breaks out of the casing of a unit, the sound from the inlet and outlets of the unit does not form part of this measurement.